SE1032

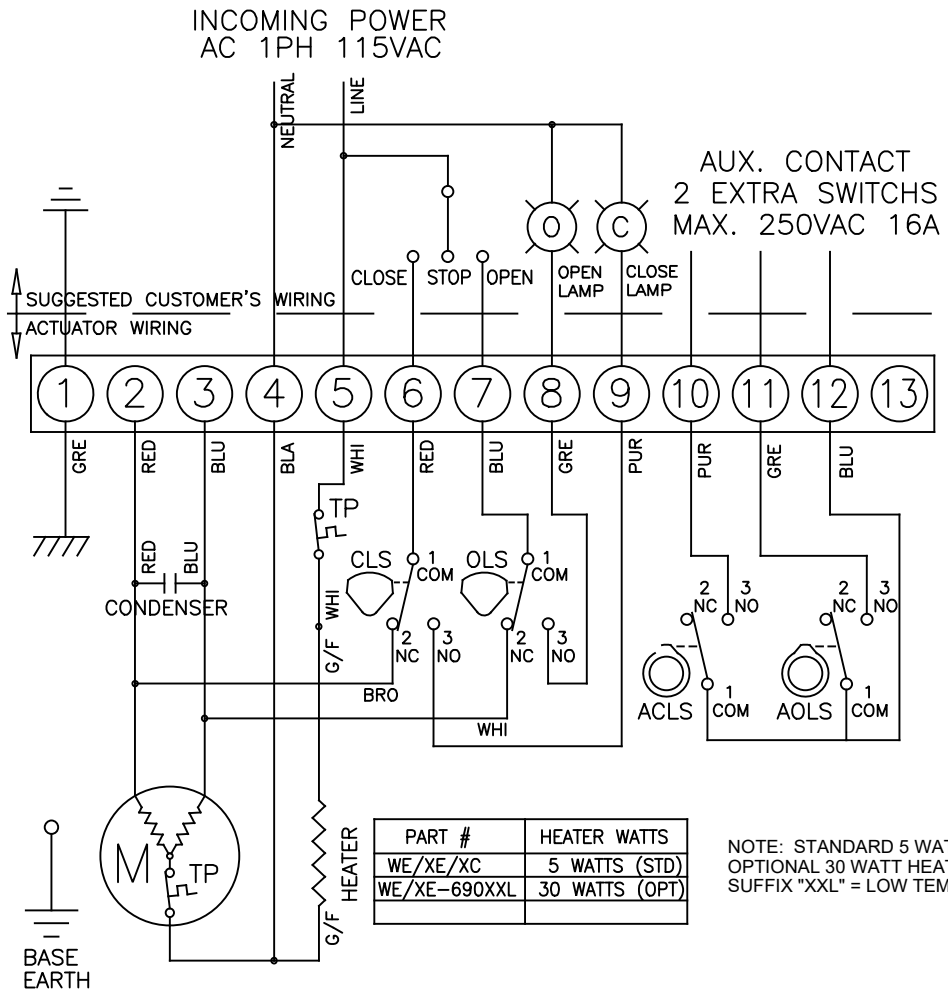

TORQUE AND LIMIT SWITCH OPERATION

SWITCH	CLOSE ◄	INTERMEDIATE	► OPEN
CLS 1–2			
CLS 1–3			
OLS 1–2			
OLS 1–3			

SYMBOL	DESCRIPTION	RATING
CLS	CLOSE LIMIT SWITCH	250VAC 10A
OLS	OPEN LIMIT SWITCH	250VAC 10A
TP	THERMAL PROTECTOR	250VAC 15A

*EACH ACTUATOR SHOULD BE POWERED THROUGH IT'S OWN INDIVIDUAL SWITCH OR RELAY CONTACTS TO PREVENT CROSS FEED BETWEEN TWO OR MORE ACTUATORS.

PART #	HEATER WATTS
WE/XE/XC	5 WATTS (STD)
WE/XE–690XXL	30 WATTS (OPT)

NOTE: STANDARD 5 WATT HEATER RATED TO -4 DEG F
OPTIONAL 30 WATT HEATER RATED TO -40 DEG F
SUFFIX "XXL" = LOW TEMPERATURE OPTION (WE/XE ONLY)

THE DESIGN AND DISCLOSURE CONTAINED IN THIS DRAWING WAS ORIGINATED BY, AND IS EXCLUSIVE PROPERTY OF A-T CONTROLS, INC. IT IS FURNISHED FOR VENDOR INFORMATION ONLY AND IS NOT AN AUTHORIZATION -OR- LICENSE TO MAKE THIS CONSTRUCTION OR TO FURNISH THIS INFORMATION TO OTHERS. ALL DRAWINGS MUST BE RETURNED TO A-T CONTROLS, INC. ON DEMAND. THIS DRAWING IS NOT TO BE REPRODUCED OR COPIED IN ANY FORM WITHOUT THE EXPRESS WRITTEN PERMISSION OF A-T CONTROLS, INC.

ECN#	DATE	BY
1569	10/27/14	SAH

TRIAC CONTROLS

Division of A-T Controls, Inc.
11363 Deerfield Road
Cincinnati, Ohio 45242
Phone: (513) 247-5465
Fax: (513) 247-5462

DRAWN	CHECKED BY	APPROVED
SAH		
DATE 11/13/04	DATE	DATE

TITLE
WE/XE-690, XC-00690/00860 WIRING DIAGRAM
TWO POSITION
115VAC / 1 PHASE / 50-60HZ